


DESIGN NOTES:
 1. CONCRETE 4000 PSI AT 28 DAYS,
 2. FRAMES AND COVERS ARE AVAILABLE
 UPON REQUEST.


HEIGHT	WEIGHT	ITEM #
12"	300 LBS	B-1001
24"	600 LBS	B-1002

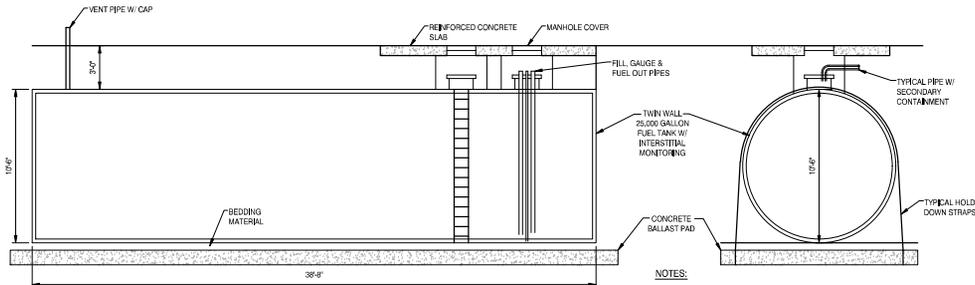

NOTES:
 1. THIS DRAWING IS SCHEMATIC ONLY. TANK MANUFACTURER TO PROVIDE SHOP DRAWINGS SHOWING TANK DIMENSIONS, OPENINGS, CONNECTIONS, VENTING AND PROTECTIVE ANODES.
 2. TANK MANUFACTURE SHALL MEET ALL REQUIREMENTS FOR REGISTRATION AS AN UNDERGROUND FUEL STORAGE TANK IN THE STATE OF MAINE.

ELECTRICAL HAND HOLE (G10)


NOT TO SCALE

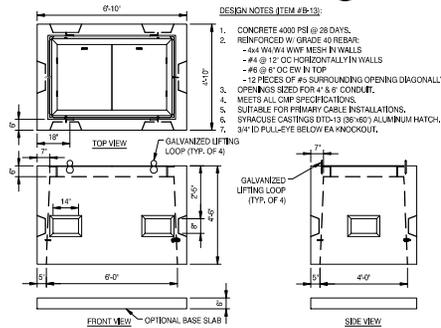

DESIGN NOTES ITEM #B-13:
 1. CONCRETE 4000 PSI @ 28 DAYS,
 2. REINFORCED W/ GRADE 40 REBAR,
 - #4 @ 12" O.C. HORIZONTALLY IN WALLS
 - #6 @ 8" O.C. CW IN TOP
 - 12 PIECES OF #6 SURROUNDING OPENING DIAGONALLY.
 3. OPENINGS SIZED FOR 4" & 6" CONDUIT.
 4. MEETS ALL CMP SPECIFICATIONS.
 5. SUITABLE FOR PRIMARY CABLE INSTALLATIONS.
 6. SYNTHUSLE CASTINGS (D15-13 (35-40)) ALUMINUM HATCH,
 3/4" ID FULLY 1/2" BELOW 6" KNOCKOUT.

UNDERGROUND FUEL STORAGE TANK (G1)

NOT TO SCALE

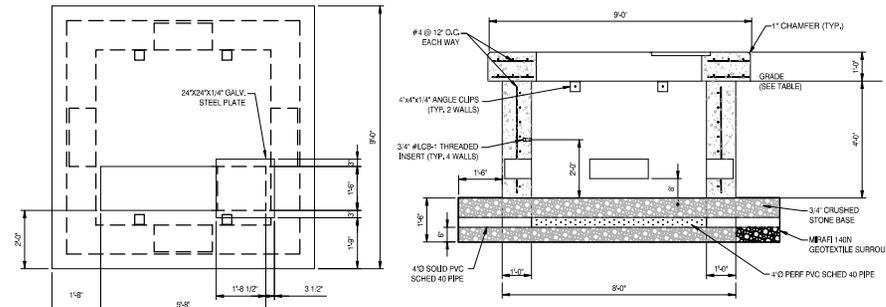


9.0' TRANSFORMER PAD (D1)

NOT TO SCALE


ELECTRICAL MANHOLE (D9)

NOT TO SCALE

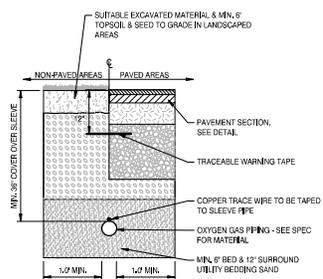

OXYGEN PIPE TRENCH DETAIL (A9)

NOT TO SCALE

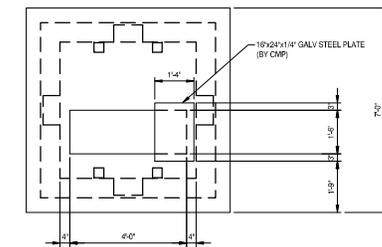

TRANSFORMER PAD NOTES:
 1. CONCRETE TO BE 4,000 PSI.
 2. PAD TO BE IN ACCORDANCE WITH LOCAL UTILITY SPECIFICATIONS.
 3. PROVIDE ONE 8" X 12" KNOCKOUT AT EACH WALL, MIN. OR AS REQUIRED.

7.0' TRANSFORMER PAD (A1)

NOT TO SCALE

REV	DESCRIPTION	DATE
0	ISSUED FOR PERMIT	5-14-19

ISSUED FOR PERMIT
5-14-19


CURRENT ISSUE STATUS

TRUE NORTH:
 SMART Architects and Engineers
 144 Fore Street P.O. Box 618
 Portland, Maine 04104
 1.877.700.7678
 www.smartinc.com

ANSOM Consulting Engineers and Scientists
 Anson Consulting Engineers and Scientists
 400 Commercial Street, Suite 400
 Portland, Maine 04101

NORDIC AQUAFARMS
 285 NORTHPORT AVENUE
 BELFAST, MAINE

**ELECTRICAL, FUEL, & GAS
 UTILITY DETAILS**



SCALE:	AS SHOWN	PROJECT NO.:	18076
PROJECT MANAGER:	ADB	A.E. OF RECORD:	ADJ
JOB CAPTAIN:	SP	DRAWN BY:	WSM

CU503
 SMART FILE: CU50318076 SHEET No. 02

NOT FOR CONSTRUCTION